


# ARCA MEDICAL BEZEL FLUSH



- IP20
- 1.5 KG
- 230v
- 5 YEAR WARRANTY
- 2W

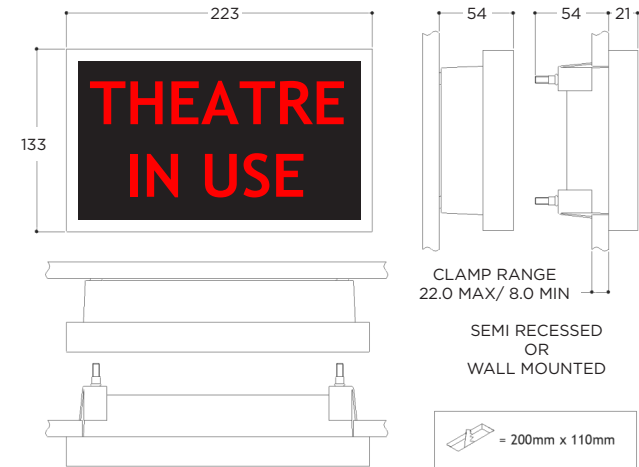

EXAMPLE PRODUCT CODE		22	ARC	F	LA	W
<b>FAMILY</b>	ARCA	22				
<b>PRODUCT</b>	SINGLE SECTION	1ARC				
	TWIN SECTION	2ARC				
<b>FRAME OPTIONS</b>	BEZEL FLUSH/ SURFACE	F				
<b>CONTROL GEAR</b>	MAINS/CENTRAL BATTERY*	LA				
<b>FINISH OPTIONS</b>	WHITE	W				
	GREY	G				
	BLACK	K				
	PENNY BRONZE	V				

- EN 60598-1
- EN60598-2-22
- EN55015
- EN61547
- EN61000-3-2

Due to rapid on/off switching cycles required by some medical diagnostic equipment, we recommend the use of our additional delay off timer. This avoids generation of high in-rush currents that may harm control relays. - Please contact our Technical Department for further advise.


For more information on colours, please go to the **Finishes Page**. For more information on Legends, please go to the **Legends Page**.

\*For input voltages please refer to our installation leaflets.

# ARCA MEDICAL FLUSH ONLY



- IP20
- 1.5 KG
- 230v
- 5 YEAR WARRANTY
- 2W

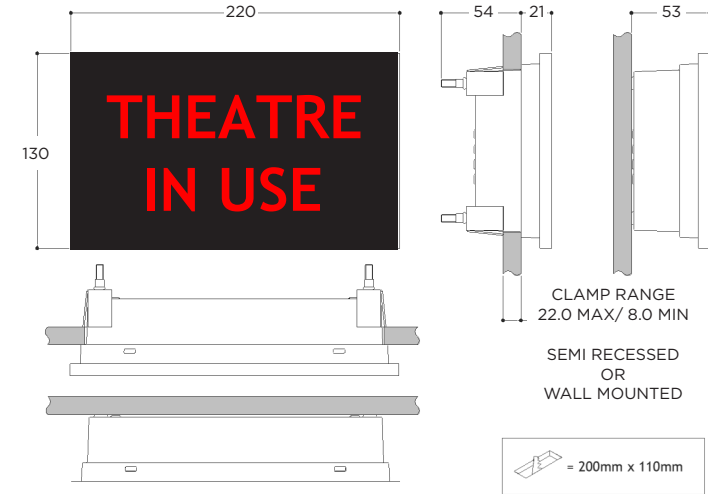

EXAMPLE PRODUCT CODE		22	ARC	G	LA	W
<b>FAMILY</b>	ARCA					
<b>PRODUCT</b>	SINGLE SECTION	1ARC				
	TWIN SECTION	2ARC				
<b>FRAME OPTIONS</b>	FLUSH ONLY	G				
<b>CONTROL GEAR</b>	MAINS/CENTRAL BATTERY*	LA				
<b>FINISH OPTIONS</b>	WHITE	W				
	GREY	G				
	BLACK	K				
	PENNY BRONZE	V				

- EN 60598-1
- EN60598-2-22
- EN55015
- EN61547
- EN61000-3-2

Due to rapid on/off switching cycles required by some medical diagnostic equipment, we recommend the use of our additional delay off timer. This avoids generation of high in-rush currents that may harm control relays. - Please contact our Technical Department for further advise.

For more information on colours, please go to the **Finishes Page**. For more information on Legends, please go to the **Legends Page**.

\*For input voltages please refer to our installation leaflets.


# ARCA MEDICAL FULL COVER



- IP20
- 1.5 KG
- 230v
- 5 YEAR WARRANTY
- 2W



- EN 60598-1
- EN60598-2-22
- EN55015
- EN61547
- EN61000-3-2

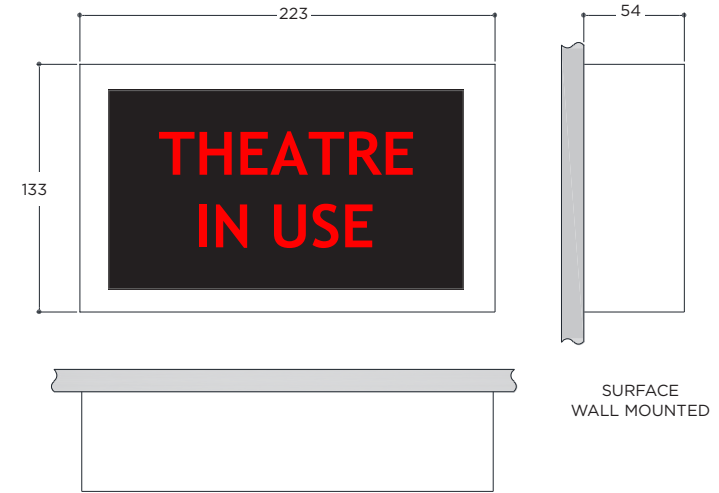

EXAMPLE PRODUCT CODE			22	ARC	S	LA	W
<b>FAMILY</b>	ARCA	22					
<b>PRODUCT</b>	SINGLE SECTION	1ARC					
	TWIN SECTION	2ARC					
<b>FRAME OPTIONS</b>	FULL COVER SURFACE ONLY	S					
<b>CONTROL GEAR</b>	MAINS/CENTRAL BATTERY*	LA					
<b>FINISH OPTIONS</b>	WHITE	W					
	GREY	G					
	BLACK	K					
	PENNY BRONZE	V					

Due to rapid on/off switching cycles required by some medical diagnostic equipment, we recommend the use of our additional delay off timer. This avoids generation of high in-rush currents that may harm control relays. - Please contact our Technical Department for further advise.

For more information on colours, please go to the **Finishes Page**. For more information on Legends, please go to the **Legends Page**.

\*For input voltages please refer to our installation leaflets.